



**FOUNDATION PLAN**

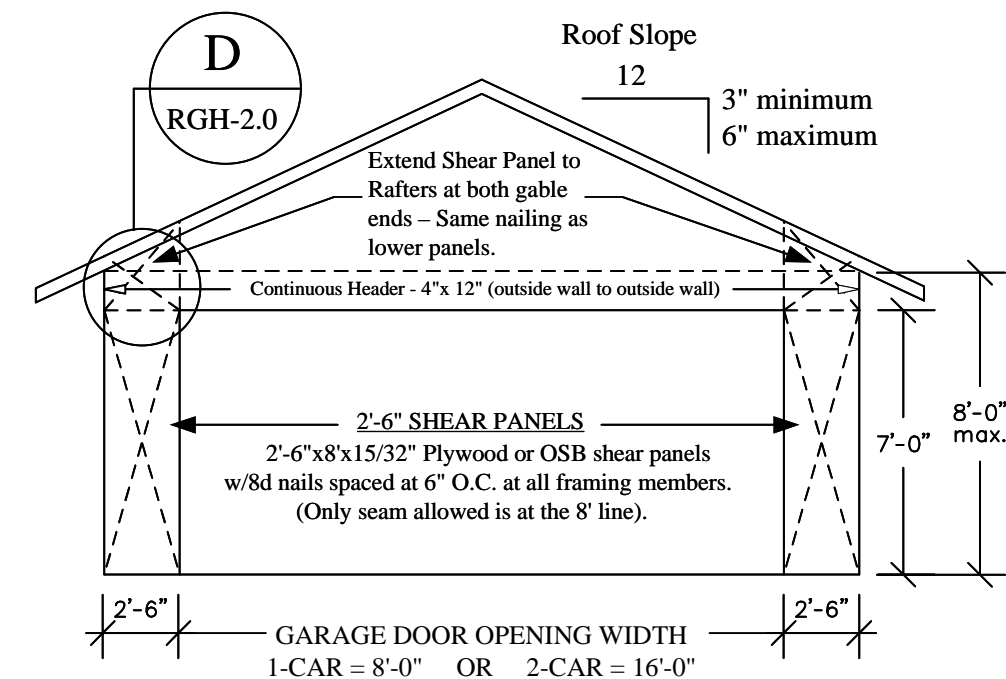


**FRONT ELEVATION**

**TYPICAL**  
4'X8'X15/32"  
Plywood or OSB  
shear panel with  
8d nails at 6"o.c.  
edges, ends, and  
field

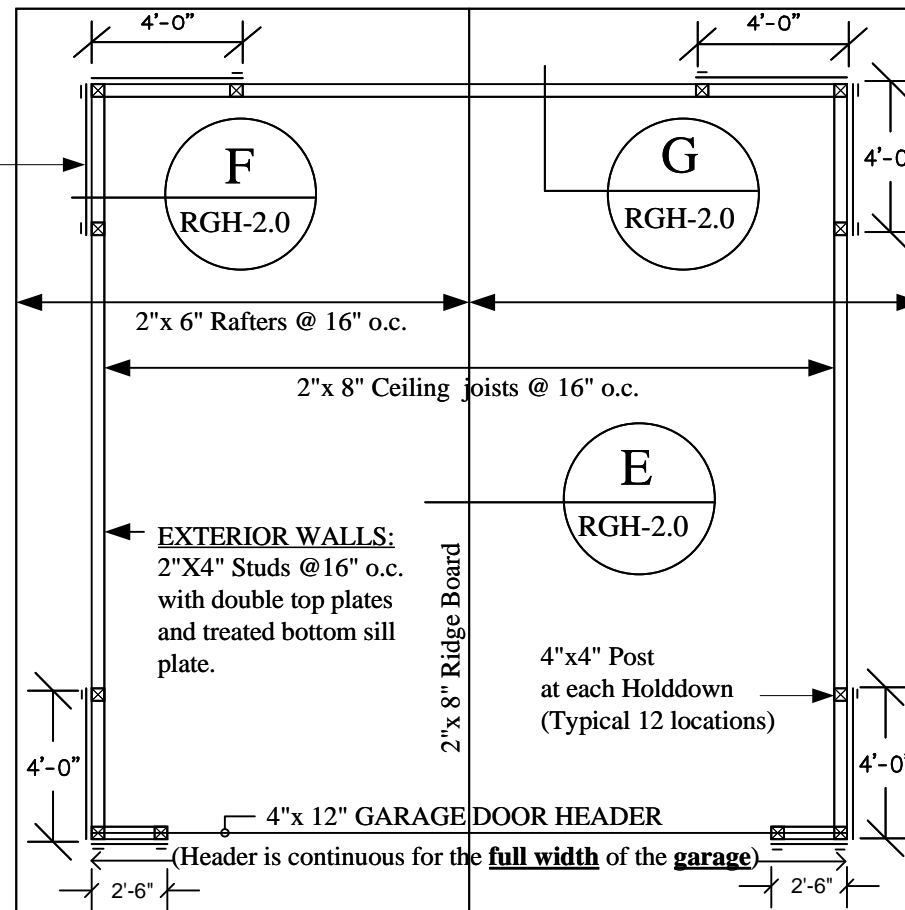

**FRAMING PLAN**

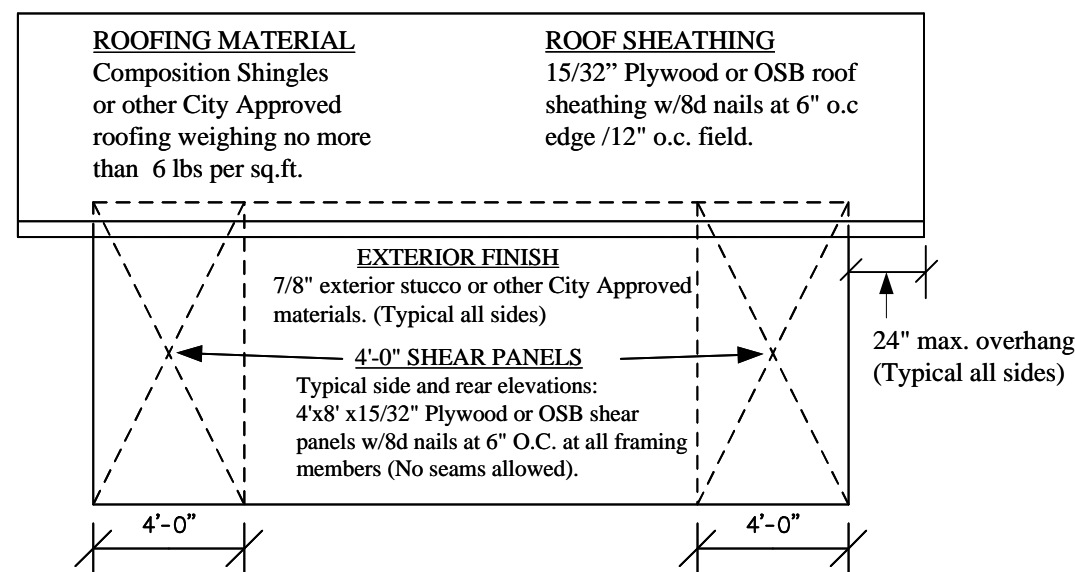

**SIDE ELEVATIONS**

## NOTES:

### FOUNDATION REQUIREMENTS

1. Minimum compressive strength of concrete shall not be less than 2500 psi (6 sack mix).
2. Sill plates shall be pressure treated or foundation grade redwood.
3. Anchor bolts shall be spaced not more than 72" O.C. (except at shear panels where at least 2 bolts are required) and shall be embedded at least 7" into the concrete.
4. Anchor bolts shall be a minimum of 1/2" diameter by 10" in length, with 3"x 3"x 0.229" plate washers.  $\triangle$
5. There shall be a minimum of two anchor bolts per piece of sill plate with one bolt located not more than 12" or less than 5" from each end.
6. Concrete slab shall not be less than 3-1/2" thick. Reinforcement recommended, but not required, to be 6"x 6" x10 gauge welded wire mesh.
7. Footings shall bear on undisturbed soil.
8. Soil at footings and under slab shall be well compacted.

### DOOR & WINDOW LIMITATIONS

One 36" wide door and one window (up to 48" wide) may be added to any wall as long as it is not located in a shear panel area. Stem wall to be omitted at doors and the headers for such doors and windows shall be a 4"x 6" Douglas Fir #2 or better.

### ALTERNATE ROOF FRAMING

Engineered roof trusses may be substituted for the rafters and ceiling joists shown on the plans. Provide calculations from the manufacturer.

### LUMBER

2"x 4" studs shall be be "Stud Grade", all other framing lumber shall be Douglas Fir, #2 grade, or better. Ceiling joists are NOT designed for attic storage.  $\triangle$

### ELECTRICAL

All electrical outlets (if any) which are less than 8' above floor level shall be GFCI protected. All electrical (if any) shall conform to the applicable codes and regulations. If electric power is provided to the garage, at least one switch controlled lighting outlet shall be provided inside the garage and one additional at the 3' garage entry door (if one is provided). Check with your Building Inspector and the Utility Department before proceeding with electrical installations.

### DISCLAIMER

Other garage designs may be possible when provided with an engineered analysis. Use of this conventional standard design is at the user's risk and carries no implied or inferred guarantee against failure or defects.



**CITY OF RIVERSIDE**

**BUILDING & SAFETY DIVISION**

3900 MAIN STREET - RIVERSIDE, CA 92522

(951) 826-5697

WWW.RIVERSIDECA.GOV

SCALE NONE

6/14/2007  
DRAWN DATE

REV. DATE APPR.

1 1/1/2008 CBC

2

3

4


5

G/BLDG/HANDOUTS/GARAGE1


**STANDARD  
DETACHED  
GARAGE**

**RGH-1.0**



SHEET

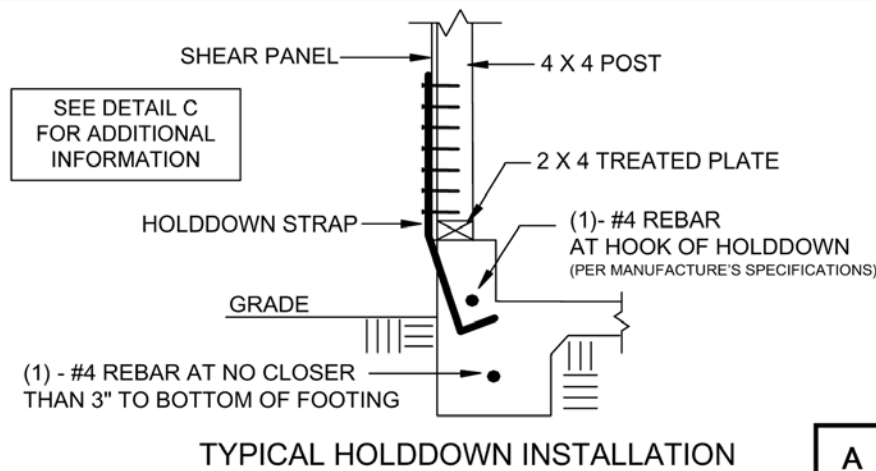





SEE NOTES ON SHEET 1 FOR ADDITIONAL INFORMATION.

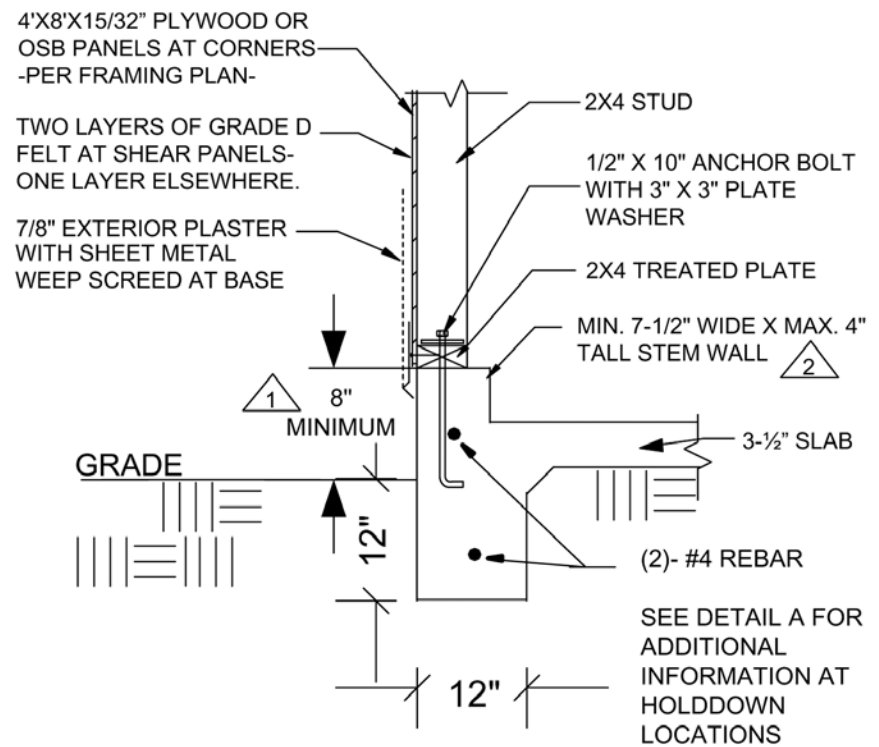

TYPICAL FOOTING & EXTERIOR WALL

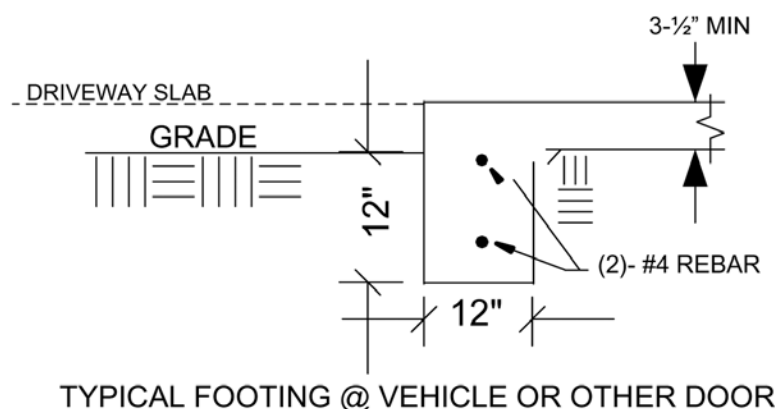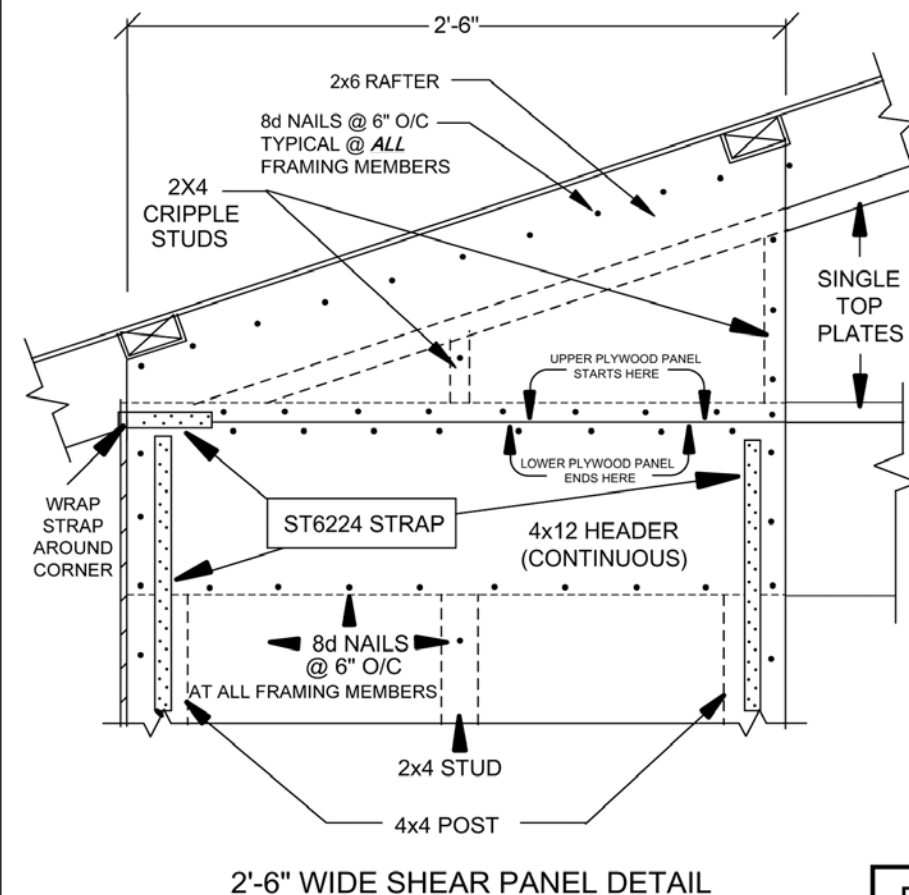

NOTE: THIS ROOF FRAMING DESIGN REQUIRES THAT CONTINUOUS 2X8 CEILING JOISTS BE PROVIDED AND ATTACHED TO EACH RAFTER AT THE TOP PLATE LINE PER DETAIL F

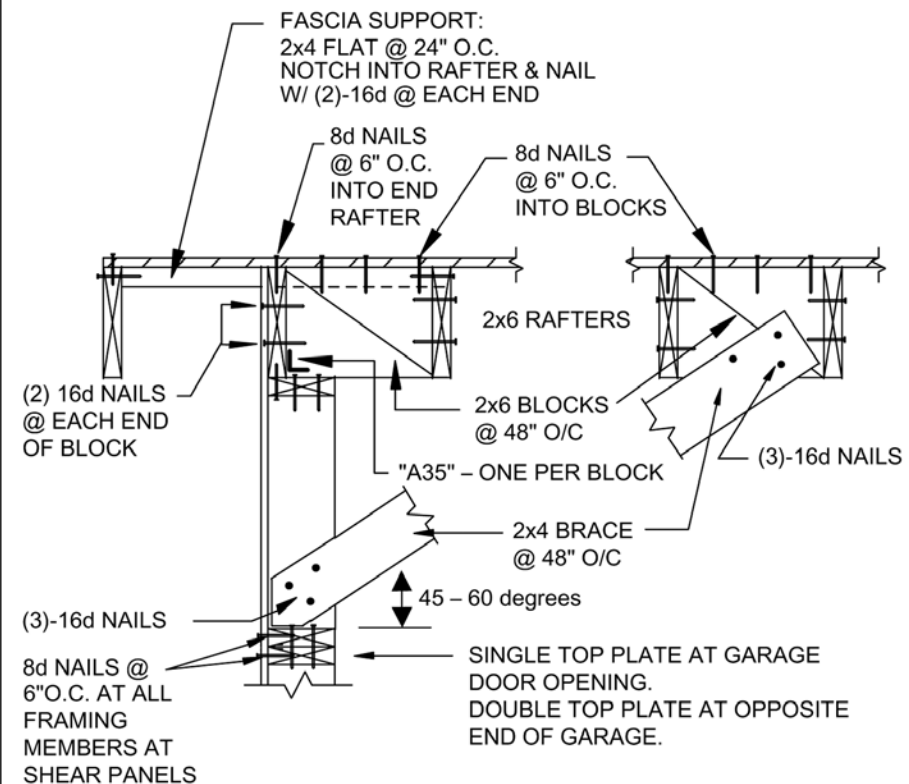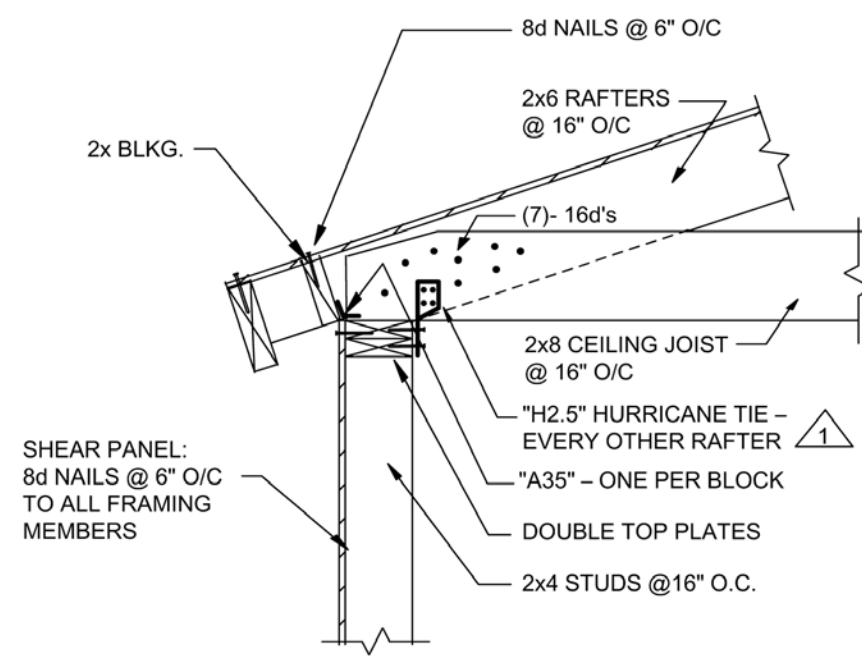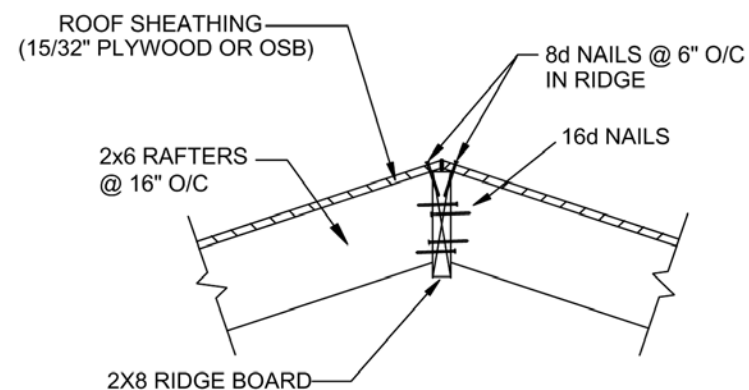

CITY OF RIVERSIDE  
BUILDING & SAFETY DIVISION  
3900 MAIN STREET - RIVERSIDE, CA 92522  
(951) 826-5697  
WWW.RIVERSIDECAL.GOV

SCALE	NONE	
6/1/2007		
DRAWN	DATE	
REV.	DATE	APPR.
1	1/1/2008	CBC
2	7/16/2008	CBC
3		
4		
5		

G/BLDG/HANDOUTS/GARAGE2  
GARAGE  
DETAILS

RGH-2.0  
SHEET